



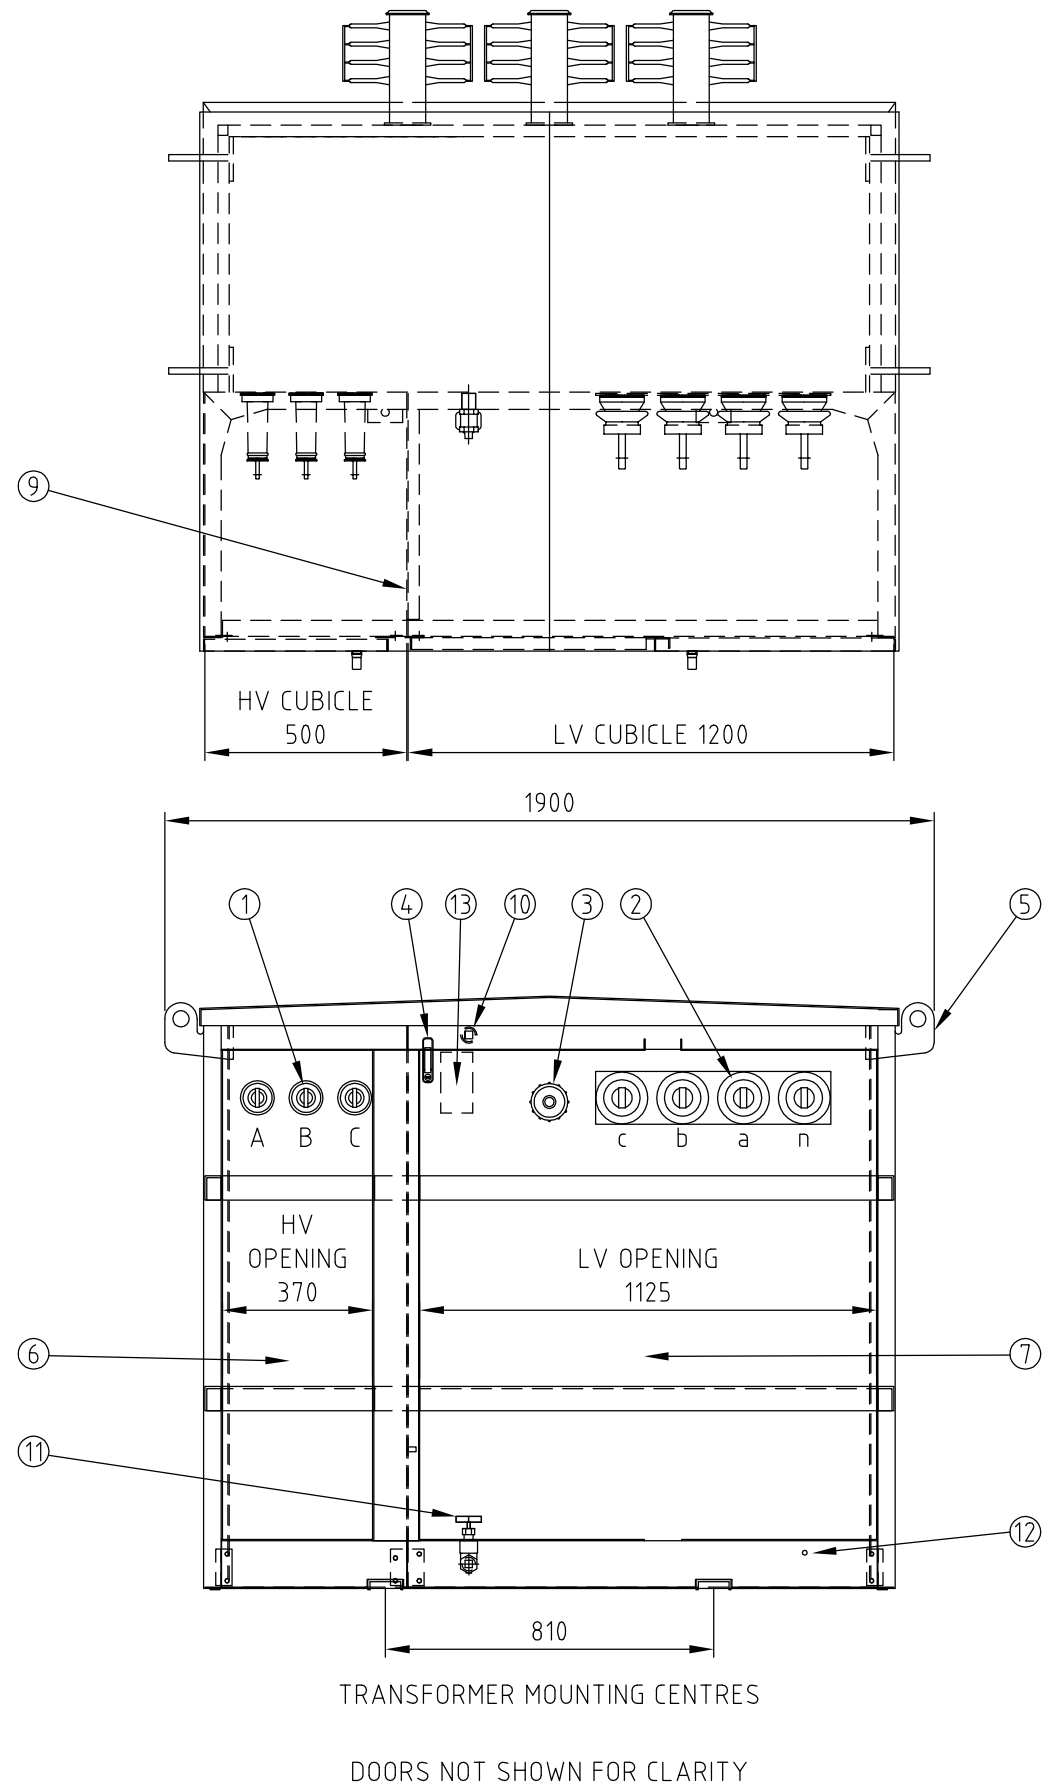

ITEM	DESCRIPTION
1	HV BUSHING – TWO PIECE 11kV, 160A
2	LV BUSHING – No 73, 1050A 1 HOLE
3	TAPSWITCH HANDLE AND BRACKET
4	OIL LEVEL GUAGE
5	LIFTING LUG
6	HV COMPARTMENT, HINGED PADLOCKABLE DOOR
7	LV COMPARTMENT, HINGED PADLOCKABLE DOOR
8	COOLING RADIATORS
9	COMPARTMENT SEGREGATION
10	FILLER SOCKET
11	DRAIN VALVE 25NB
12	EARTH STUD
13	RATING PLATE (FITTED TO INSIDE OF DOOR)

kVA	OIL Litres	UNTANKING MASS kg	TOTAL kg
500	993	1100	2650

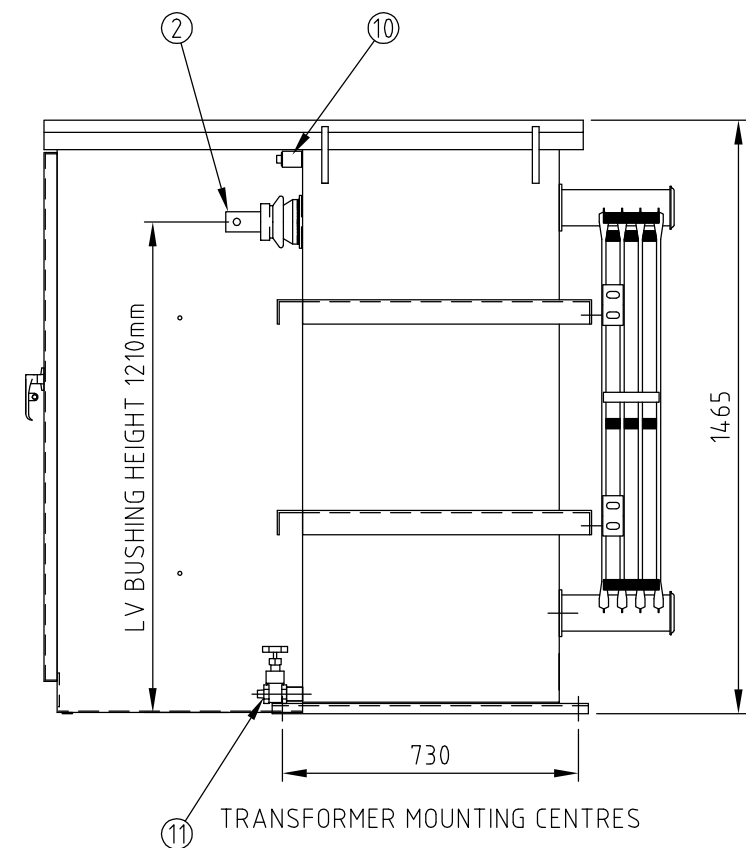

REV	DESCRIPTION	DRAWN	DATE	APPD.	DRAWN	BILL SHERA
B	GATE VALVES ADDED. BUSHINGS MOVED.	WS	05/08/10	VS	DATE	03/08/10
C	LV BUSHINGS WERE 700A	JS	09/08/18	NU	CHECKED	VIRGILIO S
.	.	.	.	.	DATE	3/8/10
.	.	.	.	.	SCALE	1=20
.	.	.	.	.	TOLERANCE	+/- 2mm

500kVA FRONT ACCESS KIOSK TRANSFORMER

GENERAL ASSEMBLY

TO SUIT DESIGN 213

ताल

Distribution Transformers

DRAWING No.
039.904.0543

REV
C